

# Comparison of DVR and D-STATCOM for Voltage Quality Improvement

Smriti Dey

*Department of Electrical and Electronics Engineering, Don Bosco College of Engineering and Technology, Assam, Don Bosco University, Guwahati-781017, India*

**Abstract**— Now a day's Improvement of Power quality has become a major area of concern in electrical power system. Increased sensitive and sophisticated loads results nonstandard voltage, current and frequency and reduce quality of power. This nonstandard power results failure of the loads connected to the distribution systems. Thus it has been very important to improve the quality of power which is very severe for the industrial customers as it can cause malfunctioning of several sensitive electronic equipments. Voltage quality is the major problem which is very severe for the sensitive electronic equipments. This paper describes voltage quality improvement by using Dynamic Voltage Restorer (DVR) and Distribution Static Synchronous Compensator (D-STATCOM). DVR or D-STATCOM is a custom power device (CPD), which is connected in series or in shunt with the network to maintain flat voltage profile in electrical distribution system. This paper presents modelling and simulation of DVR and D-STATCOM in MATLAB SIMULINK. Switching or triggering signals for the switching devices are provided by PI controller and discrete PWM generator which are used to control the output of DVR and D-STATCOM. Simulation result shows the performance of DVR and D-STATCOM under various faults such as single line to ground fault (LG), double line to ground fault (LLG), three phase to ground fault etc. The simulation result shows DVR is more efficient than D-STATCOM for power quality improvement.

**Keywords**— Custom Power Device (CPD), Dynamic Voltage Restorer (DVR), Distribution Static Synchronous Compensator (D-STATCOM), Power quality, Pulse Width Modulator(PWM).

## I. INTRODUCTION

Modern society is fully dependent on the Power generated by generating station. Electricity serves modern society example heating, cooling, light, communication, and transportation. Traditional power system comprises of three parts i.e. generation, transmission and distribution of electrical power in the form of AC. The generated power should have good quality so that it can energize all equipments or appliances equally and satisfactorily. Due to heavy loads or any abnormal conditions or faults on the line reduces the quality of the power, becomes less suitable for further applications.

Voltage magnitude is one of the major factors that determine the quality of electrical power [10] and it is necessary to improve the quality of power before further used. As utilization of power is directly related to distribution system, power quality directly affects the end users or customers. The distribution system can be defined as that part of power system which distributes electrical power to the consumer for utilization. [2] Earlier day's power system reliability was taken care-off by generation and transmission system but now a day's prime focus is on distribution system because distribution network is most affected by the electrical failures.

The power provided by generating station must be improved for delivering pure and clean power to the end users. For delivering a good quality of power Flexible AC Transmission System (FACTS) devices like static synchronous series compensator (SSSC), static synchronous compensator (STATCOM), interline power flow controller (IPFC), unified power flow controller (UPFC) etc. were used. Generally FACTS devices are modified to be used in electrical distribution system known as Custom Power Devices. Some of the widely used custom power devices are Distribution Static Synchronous Compensator (DSTATCOM), Dynamic Voltage Restorer (DVR), Active filter (AF), Unified power quality conditioner (UPQC) [4]. These devices are used to reduce power quality problems. DVR is one of the most efficient and effective custom power devices due to its fast response, lower cost and smaller size [12].

Control Unit is the main part of the DVR and D-STATCOM. The function of the control unit is to detect the voltage differences (sag or swell) in the electrical distribution system and generate gate signal to operate the Voltage Source Converter (VSC) for supplying required amount of compensating voltage. Proportional Integral (PI) Controller is used to generate control signal and a PWM Generator is used for generating switching signal, which control the output of DSTATCOM & DVR. PI controller is used as feedback controller operates with a weighted sum of error signal and generates the desired signal for the PWM generator.


The Phase locked loop (PLL) and dq0 transformation are also the basic components of the compensating device [7].

This paper presents the performance of DVR and D-STATCOM for improving voltage sag and swell under different fault conditions i.e. LG, LLG, LLLG. The theory related to operation of DSTATCOM & DVR has been discussed in the next section.

This paper composed of additional four sections. In section II, configuration of DVR & DSTATCOM is explained. In section III, operation of DVR & DSTATCOM is explained. In section IV analysis of the results of the test system are illustrated. In the last section, some conclusions are drawn.

## II. CONFIGURATION OF DVR AND D-STATCOM


Figure 1 and 2 shows the basic configuration of DVR and D-STATCOM.

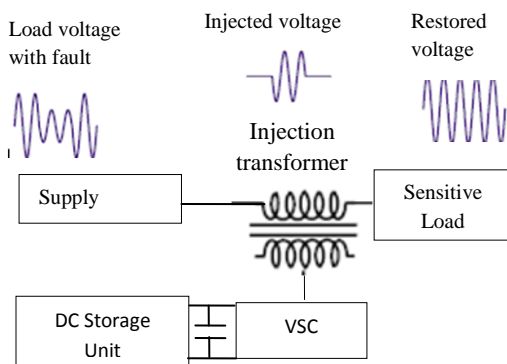

**Fig.1 Dynamic Voltage Restorer (DVR)**

DVR & D-STATCOM is a solid state power electronic switching device comprises of the following components:

(1) *DC Storage unit*: The function of this part is to supply the necessary energy to the VSC for converting DC to AC signal. Batteries are most widely used DC storage unit. The amount of voltage which has to be compensated determines the capacity of the battery.

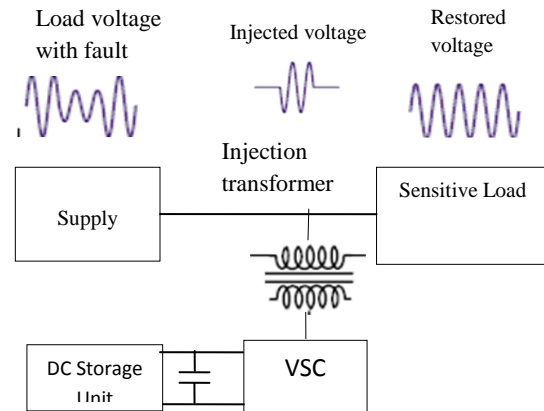


**Fig.2 Distribution Static Synchronous Compensator (D-STATCOM)**

(2) *Voltage Source converter (VSC)*: Converter used here is a voltage source inverter (VSI). It is a power electronic device consisting of IGBTs and a DC storage unit. VSI is used to generate three phase AC voltage at any required magnitude, phase and frequency to compensate the load voltage at the required value.

(3) *Injection transformer*: It is used to couple the VSC to the distribution line. The high voltage side is normally connected in series with the distribution network while the power circuit of the DVR is connected to the low voltage side [13]. The DVR inject the voltage which is required for the compensation from DC side of the inverter to the distribution network through the injection transformer. This paper uses three single phase transformers instead of a three phase transformer. Transformers are connected in series (in case of DVR) and in shunt (in case of DSTATCOM) with each phase of the distribution line. It also isolates the line from the VSC.

(4) *Control unit*: PI controller is used to generate switching signal for proper operation of VSC which detect the difference of voltage sag/swell and operate VSC to mitigate the voltage sag/swell. A comparator is used to compare load voltage with fault and the reference voltage and error signal will be generated, which drives the PI controller and the final output signal (Fig.3) controls the gate pulses for the Inverter. By multiplying error signal with constant proportional gain constant proportional response is obtained and the integral response is proportional to both the magnitude of error and duration of error.

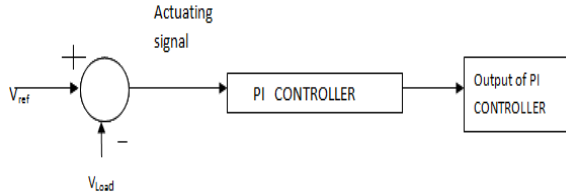

**Fig.3 Operation of PI controller [16]**

The dq0 transformation or the Park's transformation is used in this paper for voltage calculation. dq0 transformation is used to convert the three phase stationary co-ordinate to the dq0 rotating quantity and  $V_0$ ,  $V_d$  and  $V_q$  are obtained as

$$V_0 = \frac{1}{3}(V_a + V_b + V_c) = 0$$

$$V_d = \frac{2}{3} \left[ V_a \sin \omega t + V_b \sin \left( \omega t - \frac{2\pi}{3} \right) + V_c \sin \left( \omega t + \frac{2\pi}{3} \right) \right]$$


$$V_q = \frac{2}{3} \left[ V_a \cos \omega t + V_b \cos \left( \omega t - \frac{2\pi}{3} \right) + V_c \cos \left( \omega t + \frac{2\pi}{3} \right) \right]$$

### III. OPERATION OF DVR AND D-STATCOM

Among the power quality problems like sag, swell, harmonic, transients etc, voltage sag is the most severe disturbance in the power distribution system, generally caused by faults. It last for duration ranging from 3 cycles to 30 cycles [10]. Starting of large induction motors can also result in voltage sag as it draws a large amount of current during starting which will affect other equipments connected to the system. In order to mitigate voltage sag or swell in distribution system DVR & DSTATCOM is used. DVR & DSTATCOM is connected in series and in shunt with the line, injects or absorbs reactive power in order to compensate the voltage sag or swell in the distribution line and maintains flat voltage profile at the load end.

The connection of DVR with the line is shown in the Fig 1. The main function of the DVR is to boost up the voltage at load side so that equipments connected at the load end is free from any power disruption. In addition to voltage sag compensation DVR also carry out other functions such as line voltage harmonic compensation, reduction of transient voltage and fault current.

The equivalent circuit diagram of DVR and D-STATCOM is shown in Fig.4 and Fig 5.

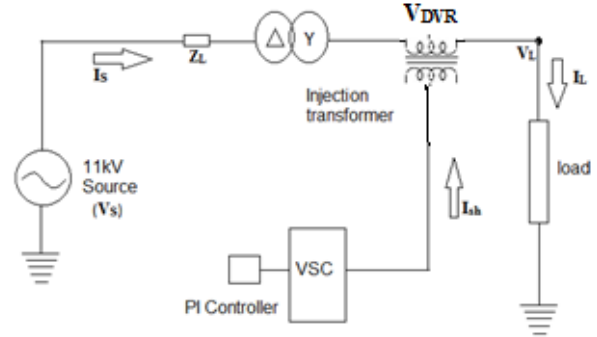

**Fig.4 Overall diagram of DVR test model**

From the equivalent circuit of DVR given in Fig.4 the equation is found to be


$$V_{DVR} = V_{load1} - V_{load2}$$

Where,  $V_{load1}$  = Desired load Voltage

$V_{load2}$  = Load voltage during fault

$V_s$  = Supply voltage to the system

The equivalent circuit diagram of a D-STATCOM is shown in Fig.5. In this diagram, the current injected or absorbed by D-STACOM ( $I_{sh}$ ) corrects the voltage sag or swell. The value of  $I_{sh}$  is controlled by the PI controller, which in turn control the output voltage of the VSC. The injected current  $I_{sh}$  can be written as

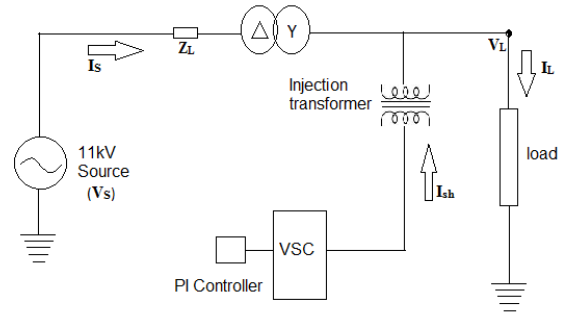

**Fig.5 Overall diagram of D-STATCOM test model**

From the Fig.5 load current can be written as,

$$I_L = I_s \pm I_{sh}$$

$$\pm I_{sh} = I_L - I_s$$


Where,  $I_L$  = Load current.

$I_s$  = Source current.

$I_{sh}$  = Shunt current injected by D-STATCOM

$Z_L$  = Line impedance.

During fault the system voltage drops from the desired load voltage and the compensating device will injects a series voltage ( $V_{DVR}$ ) in case of DVR or shunt current ( $I_{sh}$ ) in case of D-STATCOM via the injection transformer so that the load voltage can be maintained at desired value.

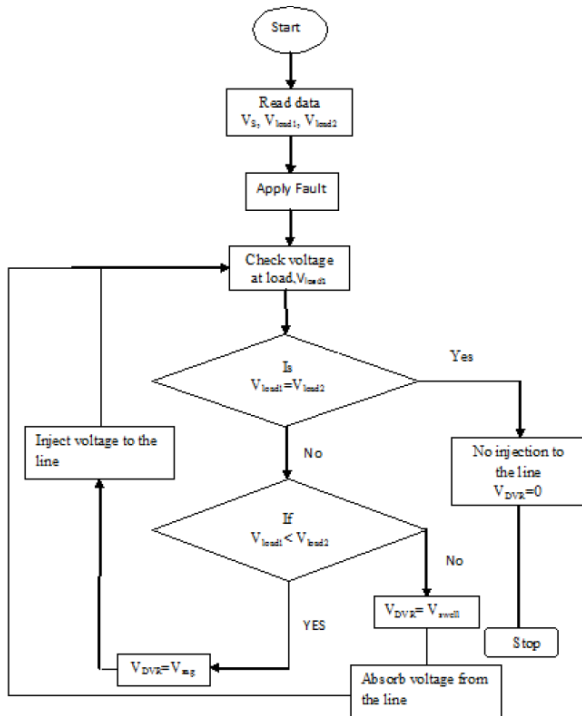

**Fig.6 Flowchart of control scheme of DVR. [17]**

The above flow chart above depicts the method which has been implemented in this paper. At the beginning magnitude of line voltage ( $V_{line}$ ) and load voltage ( $V_{load1}$ ) are measured and they are found to be equal. When a fault is applied on the distribution line the magnitude of load voltage reduce suddenly to a great extent and it becomes  $V_{load2}$ . Then  $V_{load2}$  is compared with  $V_{load1}$  if  $V_{load2}$  is equal to  $V_{load1}$ , then DVR will not operate and no injection of voltage to the line. But if  $V_{load2}$  is less than  $V_{load1}$  gate signal will be generated and DVR will inject the sag voltage  $V_{sag}$  to the main line and if  $V_{load2}$  is greater than  $V_{load1}$  DVR will absorb extra voltage. After injection the new voltage will be  $V_{load2} = V_{load1}$ . The DVR will inject voltage till it detects the difference between the load voltage before fault and after fault, i.e. the DVR will maintain the load voltage at nominal value until the fault is removed.

#### IV. RESULTS AND ANALYSIS OF DVR & DSTATCOM TEST MODEL


##### *Fault analysis:*

Application of faults on the test system created voltage fluctuations. In this section effect of various faults on the test system and their compensated load voltage waveform is also shown. The test system comprises of 11kV, 50 Hz distribution network with non-inductive three phase parallel load.

The simulation is carried out for a time duration of 100 ms i.e. from 0.1s to 0.2s with fault resistance of 0.66Ω and the ground resistance is 0.001Ω.


##### *(1) Single line to ground fault:*

Fig.7 shows input voltage and input current waveform when LG fault is applied on phase 'A'. Fig.8 shows the load voltage and load current waveform during fault without compensation. It is seen from the Fig.7 input voltage is not affected by the fault but input current is fully affected by the fault, it is increased from 10A to 400A as the fault current is supplied by the source.

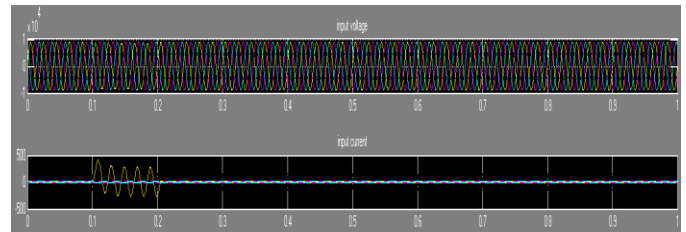

**Fig.7 Input voltage and input current waveform without compensation**


It is seen from the Fig.8 during LG fault voltage at the faulted line reduced from 10000V to 250 V i.e. voltage deep occurs at phase 'A' and voltage at the other two phases increased from 10000V to 13000V i.e. at phases 'B' and 'C' voltage swell occurs.

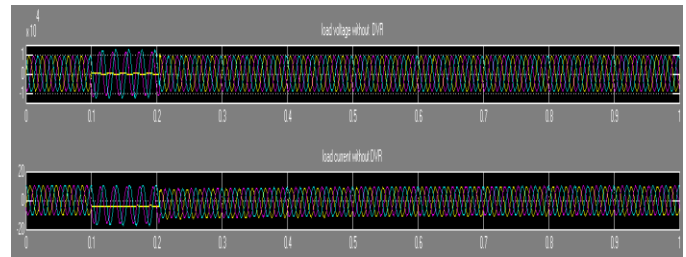

**Fig.8. load voltage and load current waveform without compensation**

#### *Compensation by using DVR:*


It is seen from the Fig.9 that load voltage during fault is almost equal to the desired load voltage. Load current magnitude is almost equal to 8A but still there is some unbalances between the phases for a small duration of time.

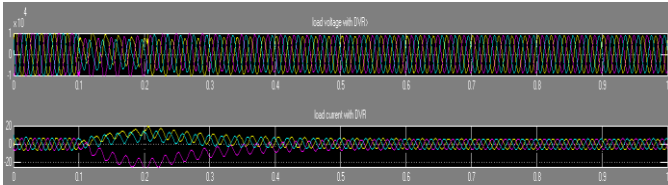

**Fig.9 load voltage and load current waveform after compensation (DVR)**

#### *Compensation by using DSTATCOM:*


When compensation is done with D-STATCOM (Fig.10) voltage magnitude is almost equal to the desired load voltage but current become unbalanced for the entire duration of time.

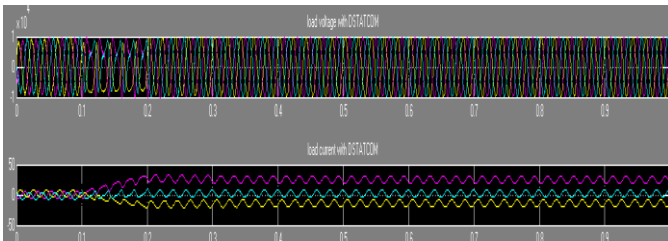

**Fig.10 load voltage and load current waveform after compensation (D-STATCOM)**


#### *(2) Double line to ground fault:*

Fig.11 shows input voltage and input current waveform when LLG fault is applied on phase 'A' and 'B'. Fig.12 shows the load voltage and load current waveform during fault without compensation. It is seen from the Fig.11 that the input voltage is not affected by the fault but input current is fully affected by the fault, it is increased from 10A to 800 A as the fault current is supplied by the source.

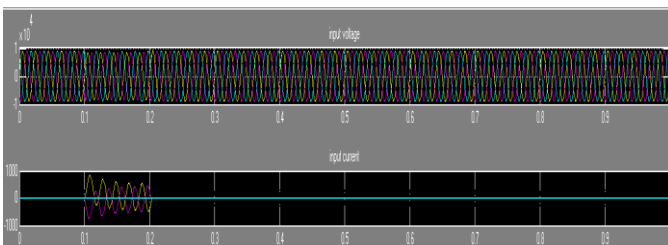

**Fig.11 Input voltage and input current waveform without compensation**


It is seen from the Fig.12 during LLG fault voltage at the faulted line reduced from 10000V to 500 V i.e. voltage deep occurs at phase 'A' and phase 'B'. Voltage at the other phase increased from 10000V to 14000V i.e. at phase 'C' voltage swell occurs.

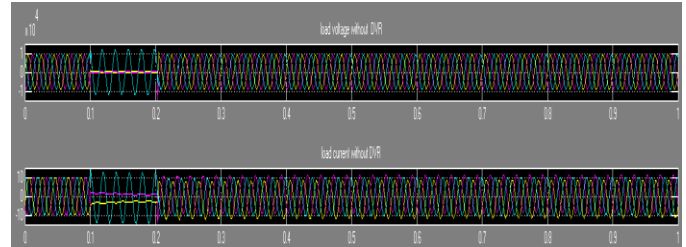

**Fig.12 load voltage and load current waveform without compensation**

#### *Compensation by using DVR:*


It is seen from the Fig.13 that load voltage during fault is almost equal to the desired load voltage. Load current magnitude is almost equal to 8 A but still there is some unbalances between the phases for a few seconds of time.

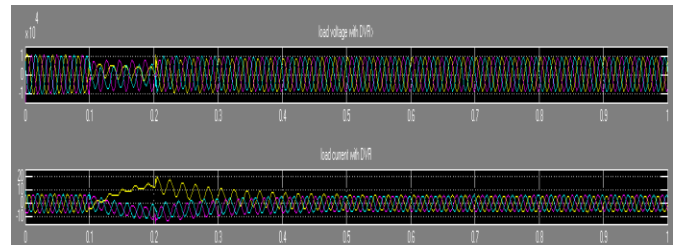

**Fig.13. load voltage and load current waveform after compensation (DVR)**

#### *Compensation by using DSTATCOM:*

When compensation is done with D-STATCOM (fig.14) voltage magnitude is almost equal to the desired load voltage but current become unbalanced for the entire duration.

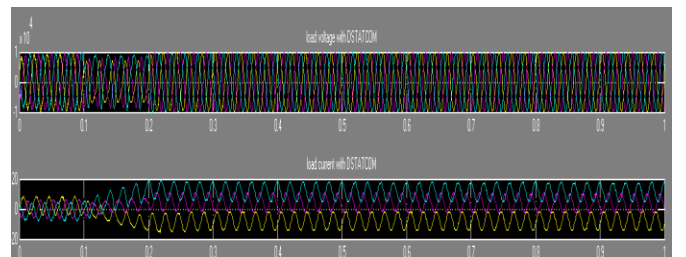


**Fig.14 load voltage and load current waveform after compensation (D-STATCOM)**




**(3) Three phase to ground fault:**

Fig.15 shows the input voltage and load voltage waveform by applying three phase fault on the test system. From the waveform it is seen that input voltage is slightly affected but input current is fully affected by the fault. Input current has increased from 10 A to 1000 A.

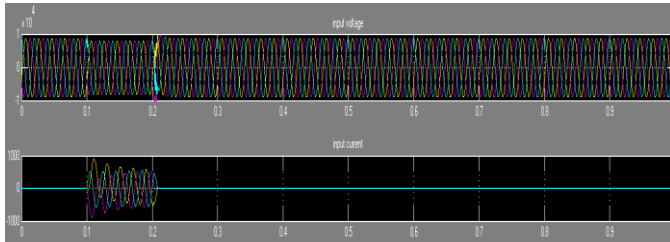


**Fig.15 Input voltage and input current waveform during fault.**

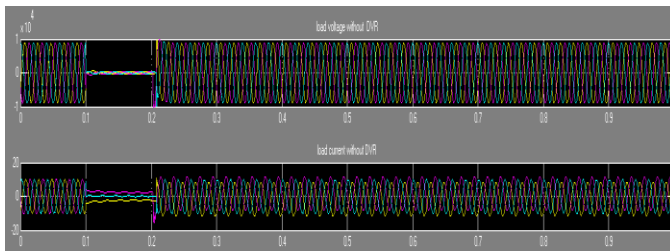


**Fig.16. Load voltage and load current during fault**

Fig.16 shows the load voltage and load current waveforms with fault and without DVR. During fault the magnitude of the load voltage decreases from 10000V to 800V and load current reduces as from 10 A to approximately 2 A as the fault is short circuit fault whole current passed through fault line. This voltage and current is to be compensated to get the desired load voltage for operating the load connected to the system satisfactorily.

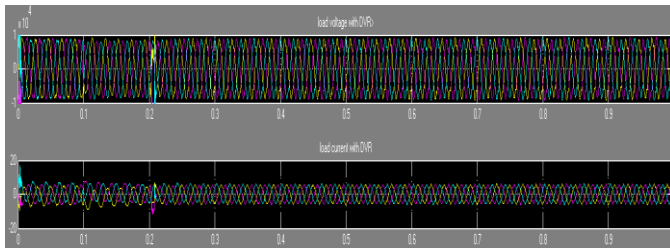

**Fig.17 Load voltage and load current with DVR**

From Fig.17 it has been observed that when DVR is connected to the line load voltage and load current almost become equal to the load voltage without fault.

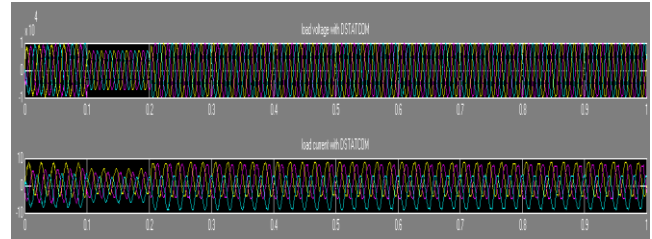

**Fig.18 Load voltage and load current after compensation (D-STATCOM)**

It has been observed from the above Figures when DSTATCOM is connected to the test system the load voltage not exactly to the load voltage without fault and load current waveform is not exactly same as the load current before the fault.

## V. CONCLUSION

In this paper, comparison of DSTATCOM & DVR is done by comparing the simulation results i.e. by comparing load voltage and load current waveforms. Simulation is done by using MATLAB SIMULINK software. Various results were obtained and analyzed by using three different types of short circuit faults. The controlling of and DSTATCOM & DVR is done with the help of PI controller. From the simulation result it is seen that compensated load voltage and load current waveforms by using DVR is much better than the compensated load voltage and load current waveforms by using D-STATCOM. The simulation results clearly showed the more efficient performance of the DVR than D-STATCOM in mitigating the voltage sag and swell due to different faults on distribution systems. DVR is one of the fast and effective custom power devices. DVR has shown the efficiency and effectiveness on voltage and current quality improvement hence it makes DVR to be an interesting power quality improvement device. This has been proved through simulation. PI controller has been used for generating operating signal of DVR & DSTATCOM, besides this other controllers like adaptive PI fuzzy controllers and fuzzy controllers can also be used in the compensation technique. In future the multilevel inverters will be a prominent choice for power electronic systems mainly for medium voltage operation. Multilevel concept is the best alternator to employ low-frequency based inverters with low output voltage distortion.

## International Journal of Emerging Technology and Advanced Engineering

Website: [www.ijetae.com](http://www.ijetae.com) (ISSN 2250-2459, ISO 9001:2008 Certified Journal, Volume 4, Issue 10, October 2014)

### REFERENCES

- [1] C. Sankaran "Power Quality", CRC Press 2002.
- [2] V.K Mehta, Rohit Mehta, Principle of Power System ( revised edition, pp 300-309)
- [3] N.G. Hingorani, Flexible AC Transmission", IEEE Spectrum, Vol. 30, pp. 40-44, 1993.
- [4] N.G. Hingorani and L. Gyugyi, Understanding FACTS – Concepts and Technology OF Flexible AC Transmission Systems, IEEE Press, New York, 2000.
- [5] N.G. Hingorani, "Introducing Custom Power", IEEE Spectrum, vol. 32, pp. 41- 48, 1995
- [6] Distribution Custom Power Task Force, 2003.
- [7] R. H. Salimin, M.S. A. Rahim, "Simulation Analysis of DVR performance for voltage sag mitigation", the 5<sup>th</sup> international power Engineering and Optimization Conference (PEOCO2011), 2011
- [8] Michael D. Stump, Gerald J. Keane "The role, of custom power products in enhancing power quality at industrial facilities", Energy Management and Power Delivery, vol. 2, pp.507-517, International Conference 1998
- [9] D. Daniel Sabin, Senior Member, IEEE, and Ambra Sannino, IEEE "A Summary of the Draft IEEE P1409 Custom Power Application Guide" Transmission and Distribution Conference and Exposition, IEEE PES, vol. 3, pp. 931-936, 2003.
- [10] M. H. Haque, "Compensation of Distribution System Voltage Sag by DVR and DSTATCOM", IEEE Porto Power Tech Conference, vol. 1, 2002.
- [11] Yash Pal, A. Swarup, Senior Member, IEEE, and Bhim Singh, Senior Member, IEEE "A Review of Compensating Type Custom Power Devices for Power Quality Improvement" IEEE Power India Conference, pp. 1-8, 2008.
- [12] Bingsen Wang, Giri Venkataramanan and Mahesh Illindala, "Operation and Control of a Dynamic Voltage Restorer Using Transformer Coupled H-Bridge Converters", IEEE transactions on Power electronics, vol. 21, pp. 1053- 1061, July06
- [13] Rosli Omar, N.A. Rahim and Marizan Slaiman, "Dynamic Voltage restorer Application for Power Quality improvement in Electrical Distribution System" Australian Journal of Basic and applied Sciences, pp 379-396, 2011
- [14] H.P. Tiwari and Sunil Kumar Gupta "Dynamic Voltage Restorer against Voltage Sag" International Journal of Innovation, Management and Technology vol. 1, no. 3, pp. 232-237, 2010.
- [15] Design and simulation of DSTATCOM for power quality Improvement.
- [16] Swapnali Hazarika, Swagata Singha Roy, Rahul Baishya, Smriti Dey, "Application of Dynamic Voltage Restorer in Electrical Distribution System for Voltage Sag Compensation", The International Journal Of Engineering And Science Vol. 2, Pages.30-38, 2013.
- [17] Smriti Dey, "Performance of DVR under various Fault conditions in Electrical Distribution System", IOSR Journal of Electrical and Electronics Engineering (IOSR-JEEE) e-ISSN: 2278-1676,p-ISSN: 2320-3331, Volume 8, Issue 1 (Nov. - Dec. 2013), PP 06-12.